



### Features

- Single zone
- Dual pipe air sampling
- 0.001% to 20% obscuration/m (0.0003% to 6.10% obscuration/ft)
- 4 Alarms - Alert, Action, Fire 1, Fire 2
- 2 x 100 m (2 x 328 ft) sampling pipe
- Enhanced performance aspirator
- Ethernet TCP/IP
- RS232 and RS485 Modbus
- 5 relay outputs and expandable
- Optional relay module and 4 to 20 mA analog output module
- Event Log
- Area coverage of up to:
  - 2000 m<sup>2</sup> (21,500 ft<sup>2</sup>) for VdS installations
  - 1600 m<sup>2</sup> (17,200 ft<sup>2</sup>) for NF installations
  - 850 m<sup>2</sup> (9,150 ft<sup>2</sup>) for UL installations

The ICAM IFT-P detector is an air-sampling system with an alarm sensitivity range from 0.001% to 20% obscuration/m (0.0003% to 6.10% obscuration/ft). This detector is classified as a Very Early Warning Smoke Detector that can reliably detect fire at an early stage, and low to high concentrations of smoke over an area of up to 2000 m<sup>2</sup> (21 500 ft<sup>2</sup>).

The detector is configurable for a variety of environments, providing an ideal fire detection solution for telecommunications and IT facilities, and heavy industrial environments such as chemical plants, factories, warehouses and mining facilities.

### How it works

The IFT-P detector draws air through sample holes in a pipe network, then filters and analyzes the sample in a laser detection chamber. Individually programmable alarm states (Alert, Action, Fire 1 and Fire 2) are shown on the display, which contains four alarm LEDs and an OK/Fault LED. Dedicated output relays also provide interfaces for each alarm state and device faults.

### Product Features

#### Programming and Configuration

RS232, RS485 and TCP/IP communication interfaces are available to connect to Xtralis Configuration and Fire System Management software packages: Xtralis VSC and Xtralis VSM4. RS485 interfaces also allow connections to remote displays, and the TCP/IP Ethernet interface can provide access to an email messaging service.

#### Inputs and Outputs

The IFT-P detector supports a maximum of three optional modules, which provide the detector with additional programmable output relay interfaces, and 4 to 20 mA analog outputs.

#### Aspiration and Flow Sensing

The aspirator is a 2000 Pa high pressure and high volume fan, which provides superior detection times over long pipe lengths and reliable detection in high air flow environments. Airflow in each pipe is monitored by a dual element thermal sensing system, with airflow faults indicated on the display and to monitoring equipment.


### Listings/Approvals

- UL
- ULC
- FM
- CCC
- CE
- VdS
- NF
- EN 54-20
  - Class A (12 holes / 0.04% obs/m)
  - Class B (36 holes / 0.04% obs/m)
  - Class C (36 holes / 0.1% obs/m)

*Classification of any configuration is determined using ASPIRE2.*

Regional approvals listings and regulatory compliance vary between ICAM models.

## Dimensions

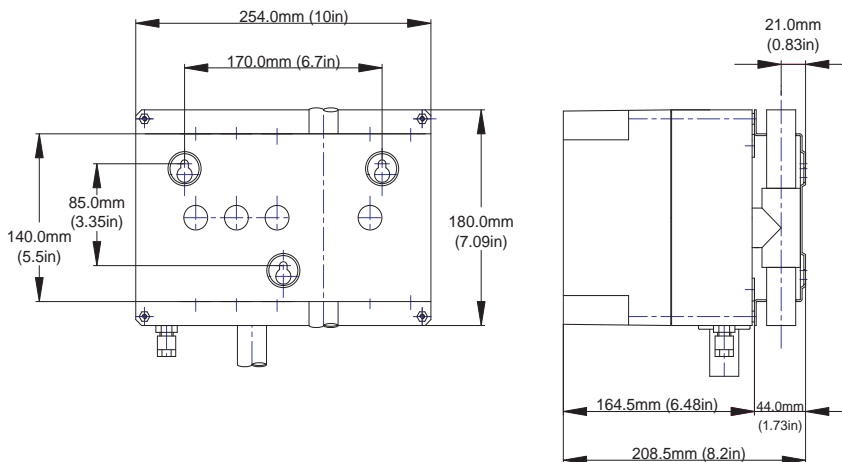

## Specifications

### Supply Voltage:

Nominal 24 VDC

### Supply Current:

500 mA (min) to 1.2 A (max)

### Capacitive Loading:

Nominal 5,000 uF

### Aspirator:

2000 Pa Centrifugal air pump

### Dimensions (WHD):

254 mm x 180 mm x 165 mm  
(10.0 in. x 7.1 in. x 6.5 in.)

### Operating Conditions:

Ambient: \*

0 to 39°C (32 to 103°F)

Tested to:

-10 to 55°C (14 to 131°F)

Sampled Air:

-20 to 60 °C (-4 to 140°F)

Humidity:

10 to 95% RH (non-condensing)

### Sampling Pipe Size:

Outer Diameter:

25 mm, or;

1.05 in (3/4" pipe) with adaptor

### Sampling Network:

Zones: 1 Fire detection zone

Pipe Length: 2 x 100 m (2 x 328 ft.)

### Alarm Sensitivity Range:

0.001% to 20% obs/m

(0.0003% to 6.10% obs/ft)

### Alarm Settings:

Alarm levels: Alert, Action, Fire 1 and Fire 2

Alarm delays: 0 to 60 seconds

*Individually programmable for each level*

### IP Rating:

IP65

### Filtration:

Field exchangeable dual stage filter

### Flow Monitoring:

Twin thermal element

### Relay Outputs:

4 alarm relays, 1 fault relay, 1 Amp changeover

Rating 1A @ 30 VDC, NO/NC

### Communication:

RS232, RS485 Modbus

Ethernet TCP/IP

### Event Log:

Up to 20,000 events stored

## Ordering Information

IFT-P 24 VDC with TCP/IP

4 Channel Relay module<sup>1</sup>

8 Channel Analog Output module (4 to 20 mA)<sup>1</sup>

IFT-1 Remote Display Module

IFT-PT

01-E606-02

01-E624-01

01-E921-01

### Notes:

1. Please contact your nearest Xtralis office for approvals status.

\* UL Listed Detector Installed Ambient conditions  
0°C to 38°C (32°F to 100°F)

### www.xtralis.com

UK and Europe +44 1442 242 330 D-A-CH +49 431 23284 1 The Americas +1 781 740 2223

Middle East +962 6 588 5622 Asia +86 21 5240 0077 Australia and New Zealand +61 3 9936 7000

The contents of this document are provided on an "as is" basis. No representation or warranty (either express or implied) is made as to the completeness, accuracy or reliability of the contents of this document. The manufacturer reserves the right to change designs or specifications without obligation and without further notice. Except as otherwise provided, all warranties, express or implied, including without limitation any implied warranties of merchantability and fitness for a particular purpose are expressly excluded.

Xtralis, Xtralis logo, The Sooner You Know, VESDA, ICAM, ECO, OSID, HeiTel, ADPRO, IntrusionTrace, and LoiterTrace are trademarks and/or registered trademarks of Xtralis and/or its subsidiaries in the United States and/or other countries. Other brand names mentioned herein are for identification purposes only and may be trademarks of their respective holder(s). Your use of this document does not constitute or create a licence or any other right to use the name and/or trademark and/or label.

This document is subject to copyright owned by Xtralis. You agree not to copy, communicate to the public, adapt, distribute, transfer, sell, modify or publish any contents of this document without the express prior written consent of Xtralis.

Doc. no. 16304\_09

Part no. 29319