




Conforms To EC Directives



Surface Mount Presence Detector PDSM362/PDSM361 Instructions

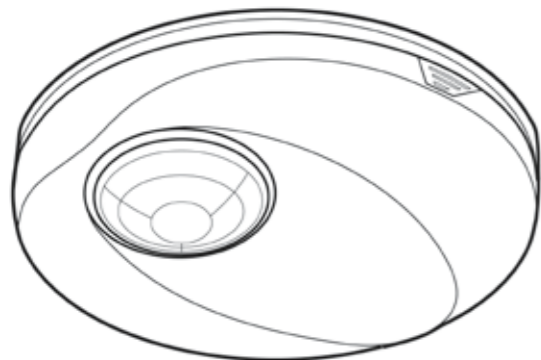

Models PDSM362/PDSM361

Technical Specifications

Rated Voltage: 230V ~ ±10% 50Hz

Loads: **PDSM362 (2 channels):**
 Load I (L1) for Lighting: μ (contact separation)
 Incandescent lamp: max. 2000W
 Mains halogen lamp: max. 1000W
 LV halogen lamp: max. 600VA
 Fluorescent lamp: max. 900VA/100μF
 LED lamp: max 400W
 Load II (D1-D2) for HVAC:
 Max. 5A (cosφ =1) 250VAC or 30VDC
 Max: 1/10HP (73W)

PDSM361 (1 channel):
 Load I (L1) for Lighting: μ (contact separation)
 Incandescent lamp: max. 2000W
 Mains halogen lamp: max. 1000W
 LV halogen lamp: max. 600VA
 Fluorescent lamp: max. 900VA/100μF
 LED lamp: max 400W

Timer Adjustment (constant adjustment):

PDSM362:
 TIME1 (for lighting): Adjustable from 5 sec. to 20 min. (continuously adjustable)
 TIME2 (for HVAC): Adjustable from 10 sec. to 60 min. (continuously adjustable)

PDSM361:
 TIME: Adjustable from 5 sec. to 20 min. (continuously adjustable)

LUX (light level) Adjustment:

Adjustable from 10 LUX to 2000 LUX (continuously adjustable)

Max. Detection Coverage: 360° cone shape from ceiling height of 2.5m giving 7m dia. coverage at floor level (for affect of ceiling height on coverage see section 3.1.1)

METER Adjustment: Adjustable continuously from + giving maximum detection coverage at floor level to – giving a substantially reduced detection coverage at floor level

Operating Temperature: 0°C to +45°C

Environmental Protection: Class II, IP40



All procedures indicated in this manual must be carried out by a professional installer.

1 Package Contents

Visual I.D.					
Item	Sensor	Instructions	Wood screw Ø4 x 25.4mm	Self-tapping screw Ø3 x 10mm	IR10 (optional purchase)
Quantity	1	1	2	2	

2 Product Description

2.1 Features

The PDSM362/PDSM361 controller is a ceiling surface mount presence detector for indoor applications in commercial and domestic locations. PDSM361 covers lighting applications only, whereas PDSM362 can control lighting and HVAC (heating, ventilating and air conditioning) applications.

Adjustment of Time and LUX values can be made either by the dial controls on the sensor body or by the IR10 Infrared remote control.

- PDSM362 has two relays for outputs load I and load II: load I is for lighting control and load II has voltage free contacts for HVAC control which operate at all LUX (light) levels.
- The sensor has a very high density of sensitive beams covering the detection area. These are evenly distributed ensuring no dead spots and detection of the smallest movements.
- Either side or bottom cable entry.
- Built-in red LED in sensor giving confirmation of remote control settings and easy test operation.

2.2 Dimensions (see Fig. 1)

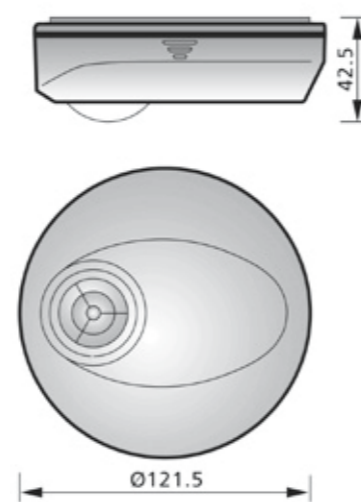


Fig. 1

3 Installation and Wiring



Please disconnect power completely and read the entire instruction manual carefully before installation.



PDSM362 – 6A breaker

A circuit breaker (250VAC,6A) type C according to EN60898-1 of load shall be installed in the fixed wiring for protection of load II.

PDSM361, PDSM362 – 10A breaker


A circuit breaker (250VAC,10A) type C according to EN60898-1 of load shall be installed in the fixed wiring for protection of load I.

3.1 Select the required location

3.1.1 Sensor adjustment

Fig. 2 shows the way coverage alters with ceiling height and with adjustments of the METER dial setting.

Side View



Top View (showing individual beam pattern at floor level)




Fig. 2

Ceiling Height (H)

2m
2.5m
3m
3.5m
4m
4.5m

Detection Coverage Diameter (D) with METER on +

7m
7m
10m
12m
12m
12m

If the METER control is turned to – the coverage diameter is substantially reduced.

We do not recommend the use of these units with ceiling heights greater than 4.5m.

3.1.2 Helpful tips for installation

As the sensor responds to temperature change or moving heat sources, please avoid the following conditions:

- Avoid highly reflective surfaces within the detection range.
- Avoid movable objects e.g. curtains and plants in the detection range (these may cause erroneous detections when moved by air flow from fans or air conditioner).
- Avoid heat sources (e.g. heating vents, radiators, air conditioners and filament lamps) in detection range.
- Avoid fans drawing air across the sensor lens.

3.2 Wiring

3.2.1 Lighting and HVAC are controlled by one PDSM362 (see Fig. 3).

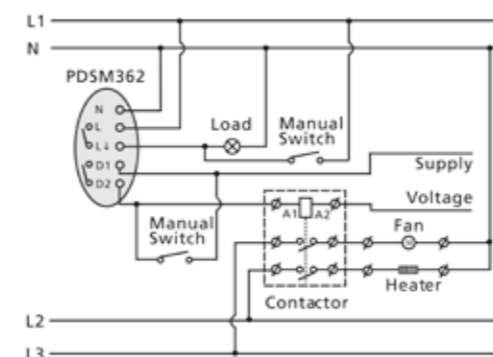


Fig. 3

3.2.2 Lighting is controlled by two PDSM362's to enlarge detection range (see Fig. 4).

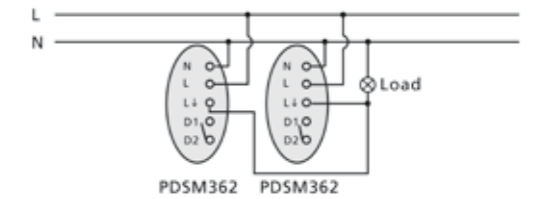


Fig. 4

3.2.3 Lighting is controlled by a PDSM361 (see Fig. 5).

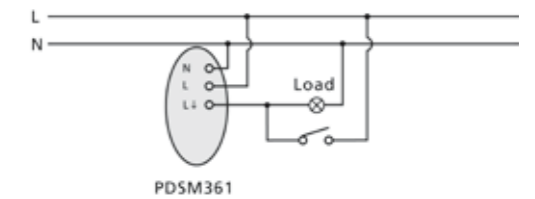


Fig. 5

3.3 Installation procedure

3.3.1 Insert large flat blade screwdriver into the groove as shown each side in turn and twist (see Fig. 6) to remove outer cover.

3.3.2 To separate bottom case from lens body force a small flat blade screwdriver into the hidden gap shown partially exposed in Fig. 7 then push screwdriver in towards centre and lever bottom case assembly away from lens body pins.

3.3.3 Remove cardboard and screws used to assemble and fix the sensor (see Fig. 8).

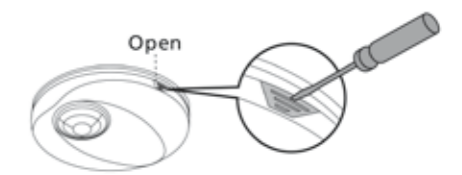


Fig. 6

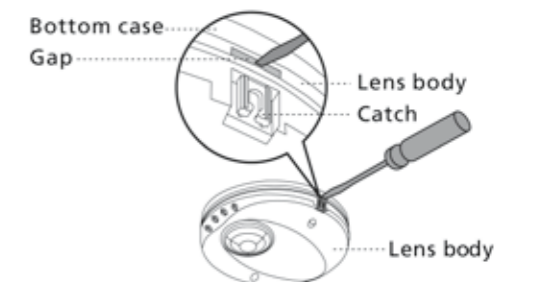


Fig. 7

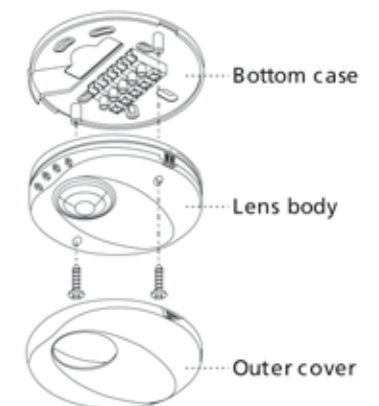


Fig. 8

3.3.4 There are two methods of cable entry into the unit. One feeds into the bottom case (Fig. 9-A), another feeds into the side of the bottom case and outer cover (Fig. 9-B). Select your preferred cable entry and score round the appropriate knock-out pattern in the bottom case with a sharp knife. If side entry is chosen the knock-out pattern in the outer cover will need to be scored as well. Push out the chosen knock-outs and feed the wires through, then connect the wires to the corresponding terminal blocks.


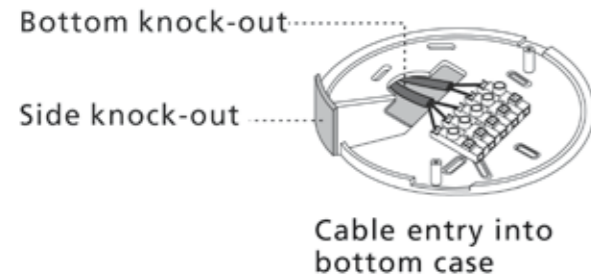


Fig. 9-A (Bottom entry)

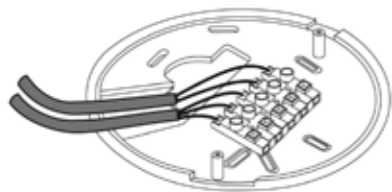

Wires enter into side entry hole



Fig. 9-B (Side entry)

3.3.5 Insert the lens body pins into the bottom case contacts, fasten it with screws firmly and snap on the outer cover (see Fig. 8).

3.3.6 Recheck and wipe slightly with a clean dry cloth if the sensor surface is dirty.

3.3.7 There is a pattern of slots on the bottom case that should enable the fixing holes of the previous unit to be used. Fasten bottom case onto the ceiling with wood screws (see Fig. 10).

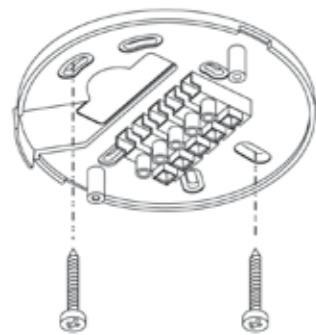


Fig. 10

3.3.8 Restore the power.

4 Test and Operation

4.1 Time, LUX and Meter Controls

Following marked values (excepting TEST and $\frac{15}{L}$) are approximate, the values are continuously adjustable over the control range (see Fig. 11-A & Fig. 11-B).

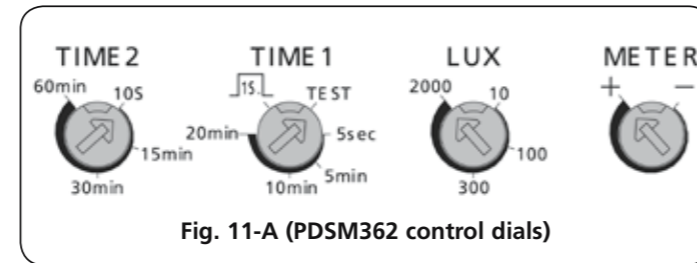


Fig. 11-A (PDSM362 control dials)

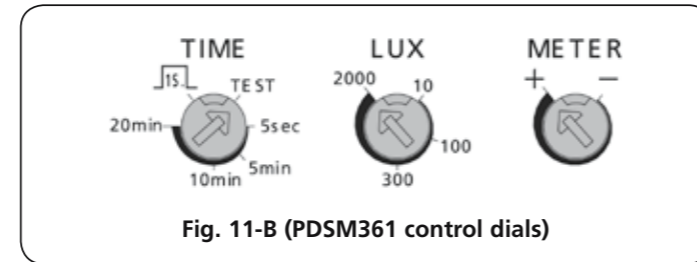


Fig. 11-B (PDSM361 control dials)

4.1.1 TIME control adjustment

These are delay times between the sensor being triggered and the controller switching off assuming no further detections are made. If there are additional detections the time delay applies from the latest detection.

PDSM362:

TIME 1: Adjustable from 5 sec. to 20 min. (lighting). (Extendable to 30 min. and 60 min. when in use with the IR10 remote controller).
TIME 2: Adjustable from 10 sec. to 60 min. (HVAC).

PDSM361:

TIME: Adjustable from 5 sec. to 20 min. (lighting). (Extendable to 30 min. and 60 min. when in use with the IR10 remote controller).

4.1.2 LUX control adjustment

The LUX level below which the sensor will operate is adjustable from 10 LUX (operation only after dusk) to 2000 LUX (operation at any light level).

4.1.3 METER control adjustment

This control sets the diameter of detection coverage at floor level. Assuming a ceiling height of 2.5m at the + end of the scale the coverage diameter will be 7m, at the - end of the scale the coverage diameter will be 1m.

The effect of METER control at other ceiling heights is shown in section 3.1.

4.2 Test Mode

4.2.1 Sensor warm up

The detector will take a minimum of 60 seconds to warm up when the power is connected to it for the first time or if the power is being re-connected after being turned off.

During this period load I and the sensor LED will both be on. After the warm up is finished the sensor will revert to operation according to the settings of the controls on the sensor body.

4.2.2 LED function

There is a red LED (see Fig. 12) built into the sensor and visible through the PIR lens that shows the status of the loads and enables testing to be carried out without the loads being connected.

If the IR10 remote controller is in use the LED will flash to give confirmation of the commands and adjustments made by the IR10.

4.2.3 Walk test

Turn supply on and wait at least 60 seconds for the system to settle down.

Turn Time 1 control to the Test position. This means that the sensor LED and load I will turn on for 2 seconds after triggering and then be off for 3 seconds after which the sensor can be re-triggered. The triggering is independent of light level.

The installer should move around in the detection area to establish that it is all covered. If necessary the METER control dial should be adjusted, after which the area should be walk tested again to confirm coverage is as required.

To confirm that load 2 (HVAC) is operating correctly for a PDSM362, carry out the following:-
Turn LUX (light level) to its minimum value (10 LUX) to stop load 1 (lights) from turning on. Then turn Time 2 (HVAC) to minimum value (10s) and carry out a limited walk test to confirm correct operation of load 2.

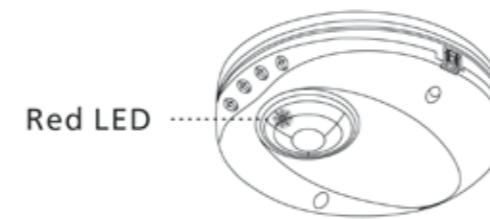


Fig. 12

5 Troubleshooting

When the PDSM362/PDSM361 is not working as expected go through the troubleshooting guide below.

Problem	Possible Cause	Suggested Solution
Lights do not turn on.	1. Power is not turned on. 2. Incorrect control dial setting. 3. Incorrect wiring. 4. Faulty load.	1. Switch on the power. 2. Check if control dials are set to the correct position, then supply the power to check if the LED will turn on. 3. Refer to wiring diagrams (Fig. 3 to Fig. 6) 4. Replace the faulty load.
Lighting or HVAC does not turn off.	1. Incorrect time setting. 2. Incorrect wiring.	1. Check that the correct delay time is set on either TIME 1 or TIME 2 control dial. Then determine if nuisance triggering is keeping the unit turned on. 2. Make sure supply and load wires are connected correctly.
LED does not turn on.	1. Out of detection range. 2. Power supply not on. 3 'TIME' knob setting isn't on 'Test' 4. Incorrect wiring.	1. Walk within the effective detection range. 2. Switch the power on. 3. Turn the control dial to 'Test' 4. Refer to wiring diagrams (Fig. 3 to Fig. 5).
Nuisance triggering.	There are heat sources, HVAC vents/fans, highly reflective surfaces or anything which may be swayed by air movement within the detection coverage.	Avoid aiming the toward any heat sources, such as air conditioners, electric fans, heaters or any highly reflective surfaces. Make sure there are no swaying objects within the detection coverage.

6 Optional Remote Control – IR10

PDSM362/PDSM361 can also be controlled by the infrared remote controller IR10. As well as allowing remote setting of times and light level the IR10 also enables continuous operation for 8 hours in ON or OFF modes as well as continuously in detection mode controlled by or independent of light level.

The IR10 is invaluable during commissioning enabling changes to be made without resorting to ladders.

Further to this the IR10 can download stored settings from one sensor to additional sensors in the same area.

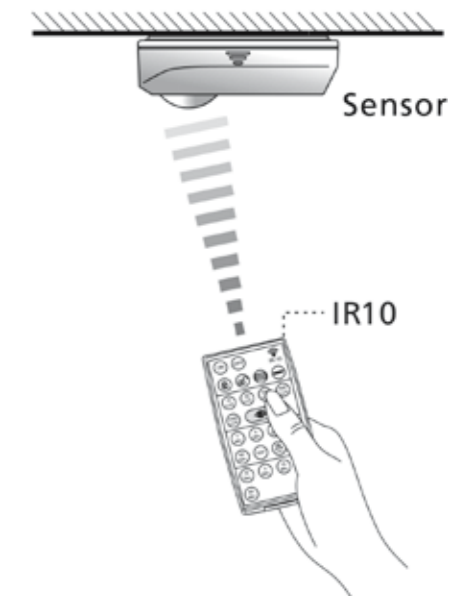


Fig. 13

3 Year Guarantee

In the unlikely event of this product becoming faulty due to defective material or manufacture within 3 years of the date of purchase, please return it to your supplier in the first year with proof of purchase and it will be replaced free of charge. For years 2 and 3 or any difficulty in the first year telephone the helpline on **020 8450 0515**.

For assistance with the product please contact:

HELPLINE
020-8450-0515
or email helpline@timeguard.com



For a product brochure please contact:
Timeguard Ltd.
020-8452-1112
or email csc@timeguard.com

A Huber Group company

67-058-276 (Iss. 4)